


# TYPICAL CONFIGURATION NOT FOR CONSTRUCTION

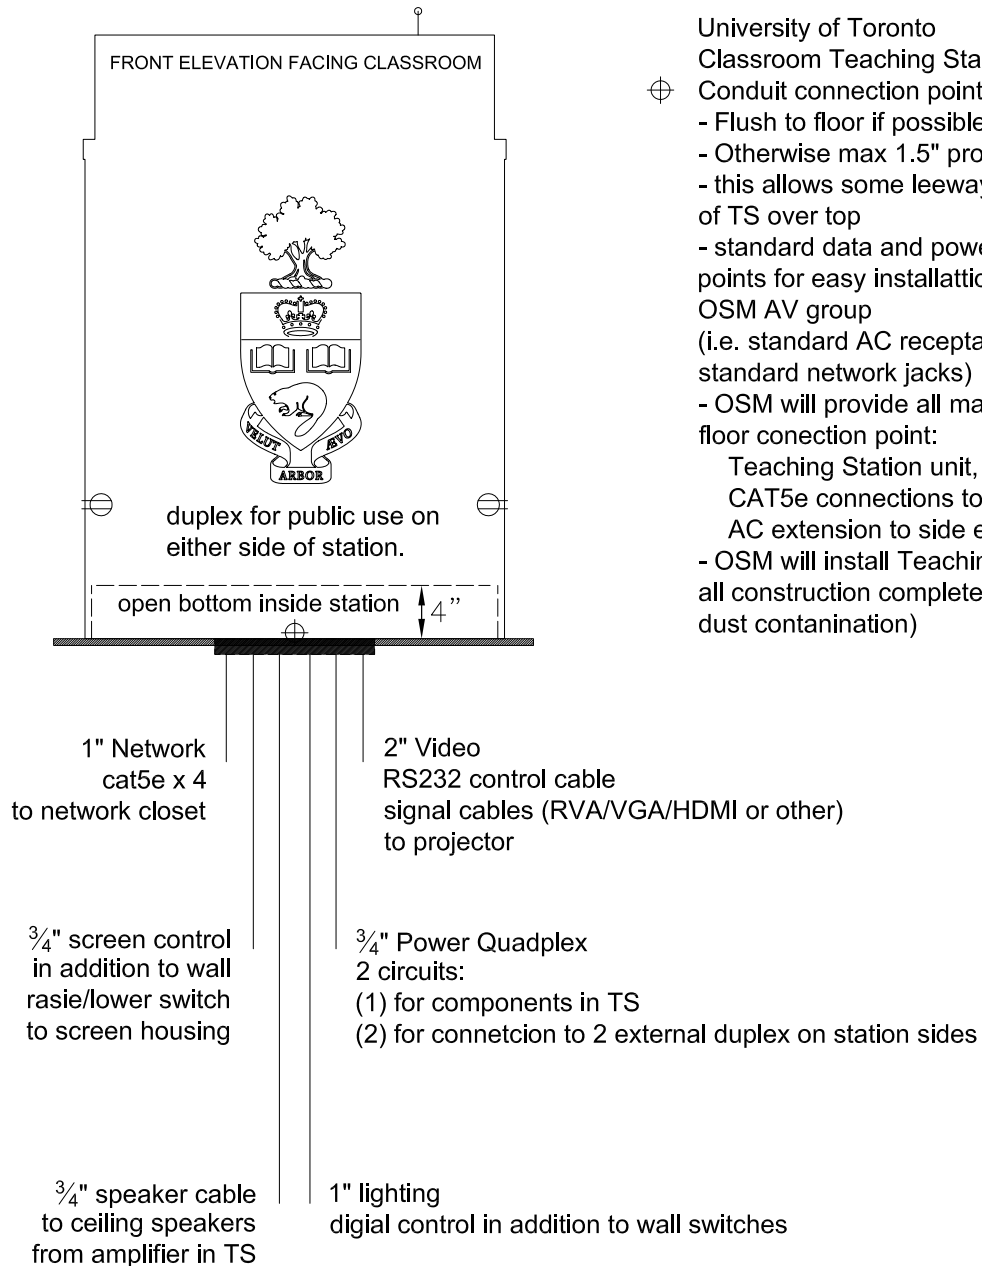

University of Toronto  
Classroom Teaching Station

⊕ Conduit connection point

- Flush to floor if possible
- Otherwise max 1.5" proud of floor
- this allows some leeway in positioning of TS over top
- standard data and power connection points for easy installation of TS by OSM AV group (i.e. standard AC receptacle quadplex, standard network jacks)
- OSM will provide all materials above floor connection point:
  - Teaching Station unit,
  - CAT5e connections to controls,
  - AC extension to side external duplex
- OSM will install Teaching Station after all construction complete (to prevent dust contamination)

\*\*\* ALL CABLING AND CONDUIT TO BE CONFIRMED ON PROJECT-BY-PROJECT BASIS; THIS IS ONLY A GENERAL GUIDELINE AND NOT FOR CONSTRUCTION

March 2012 burl.crone@utoronto.ca